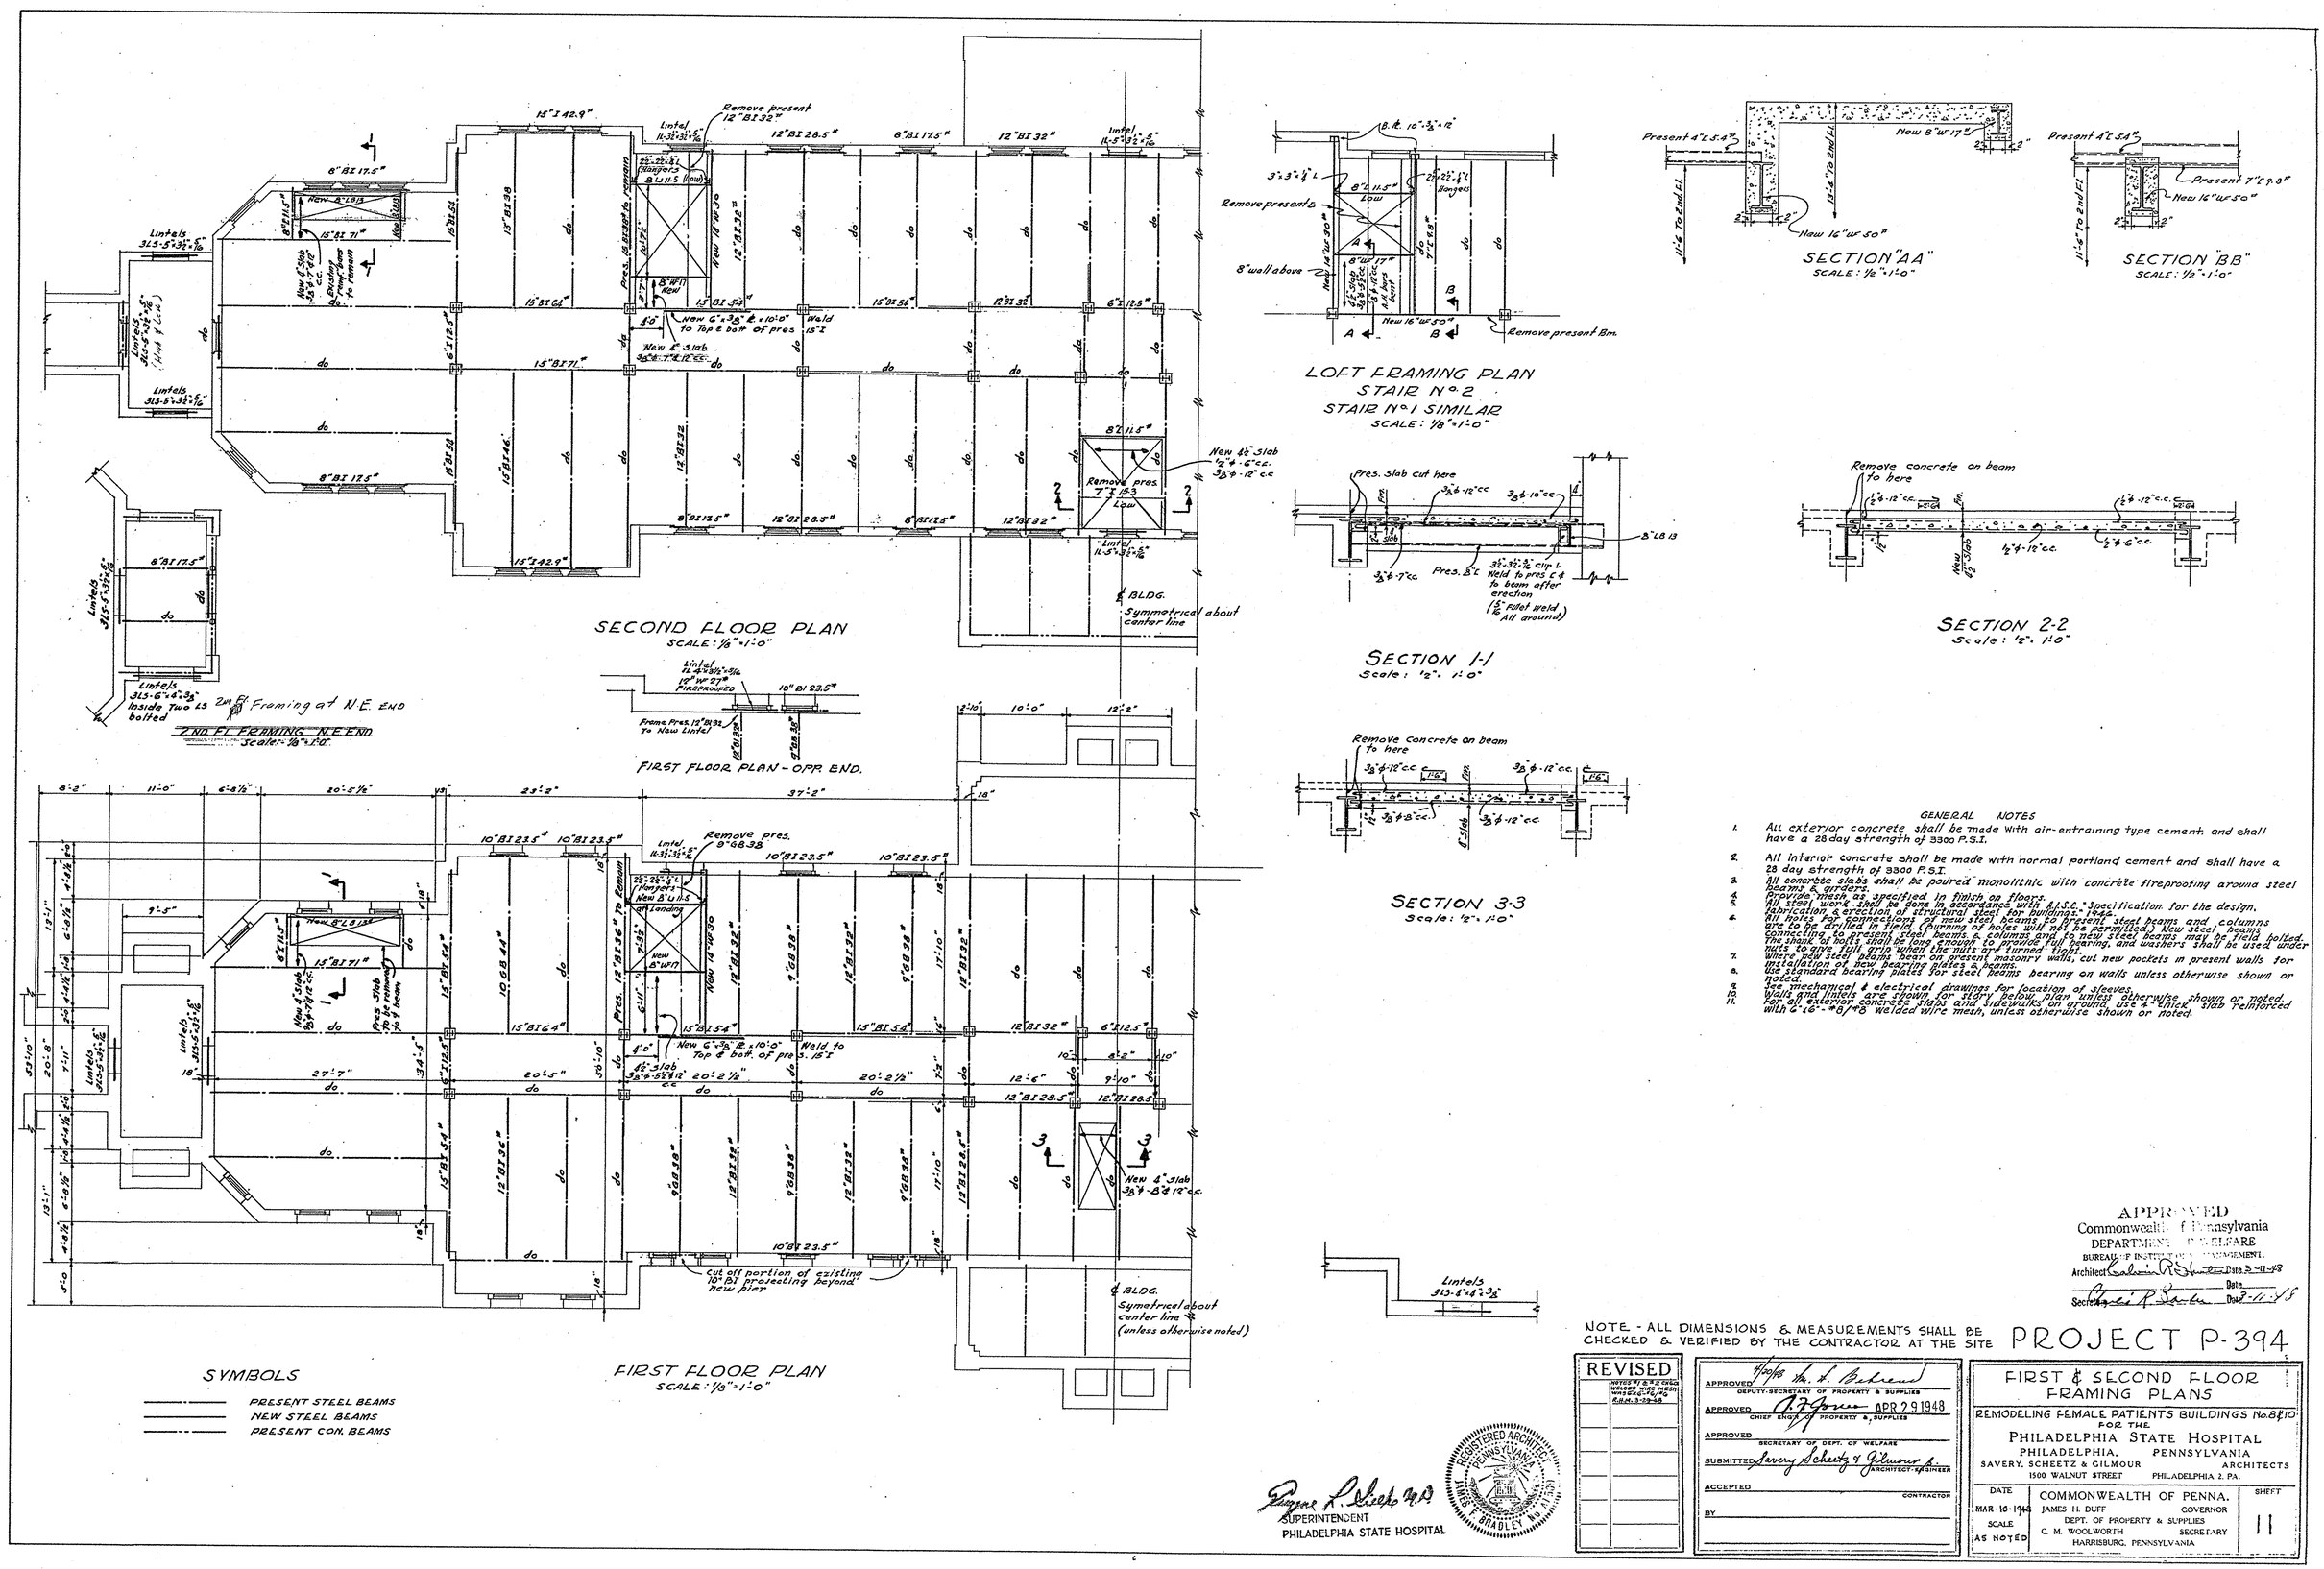

GENERAL NOTES

1. All exterior concrete shall be made with air-entraining type cement, and shall have a 28 day strength of 3300 P.S.I.
2. All interior concrete shall be made with normal portland cement and shall have a 28 day strength of 3300 P.S.I.
3. All concrete slabs shall be poured monolithic with concrete fireproofing around steel beams & girders.
4. Provide mesh as specified in finish on floors.
5. All steel work shall be done in accordance with A.I.S.C. "Specification for the design, fabrication & erection of structural steel for buildings." 1944.
6. All holes for connections of new steel beams to present steel beams and columns are to be drilled in field. (Punching of holes will not be permitted.) New steel beams connecting to present steel beams & columns and to new steel beams may be field bolted. The shank of bolts shall be long enough to provide full bearing, and washers shall be used under nuts to give full grip when the nuts are turned tight.
7. Where new steel beams bear on present masonry walls, cut new pockets in present walls for installation of new bearing plates & beams.
8. Use standard bearing plates for steel beams bearing on walls unless otherwise shown or noted.
9. See mechanical & electrical drawings for location of sleeves.
10. Walls and lintels are shown for story below plan unless otherwise shown or noted.
11. For all exterior concrete slabs and sidewalks on grade, use 4" thick slab reinforced with 6'-6" - #8/#8 welded wire mesh, unless otherwise shown or noted.

APPROVED
Commonwealth of Pennsylvania
DEPARTMENT OF WELFARE
BUREAU OF INSTITUTIONAL MANAGEMENT.
Architect Date 3-11-48
Secretary Date 3-11-48

NOTE - ALL DIMENSIONS & MEASUREMENTS SHALL BE CHECKED & VERIFIED BY THE CONTRACTOR AT THE SITE

PROJECT P-394

REVISED	
NOTES #1 & #2 CHGD. WELDED WIRE MESH WAS 6"-6"-#4/#4	
R.W.H. 3-29-48	

APPROVED 4/29/48 Wm. L. Bechtel
DEPUTY-SECRETARY OF PROPERTY & SUPPLIES
APPROVED APR 29 1948
CHIEF ENGINEER OF PROPERTY & SUPPLIES
APPROVED
SECRETARY OF DEPT. OF WELFARE
SUBMITTED Savery Scheetz & Gilmour A.
ARCHITECT-ENGINEER
ACCEPTED
CONTRACTOR
BY

FIRST & SECOND FLOOR FRAMING PLANS

REMODELING FEMALE PATIENTS BUILDINGS No. 8 & 10 FOR THE PHILADELPHIA STATE HOSPITAL
PHILADELPHIA, PENNSYLVANIA

SAVERY, SCHEETZ & GILMOUR ARCHITECTS
1500 WALNUT STREET PHILADELPHIA 2, PA.

DATE	COMMONWEALTH OF PENNA.	SHEET
MAR. 10. 1948	JAMES H. DUFF GOVERNOR	11
SCALE	DEPT. OF PROPERTY & SUPPLIES	
AS NOTED	C. M. WOOLWORTH SECRETARY	
	HARRISBURG, PENNSYLVANIA	

3-7-1